

### **HYDRAULIC DESIGN**

### **FLOW CAPACITY**

The hydraulic capacity of a pipeline can vary due to various factors, which include:

- Growth of slime, which will vary with the age of the pipeline and available nutrient in the water.
- Roughening, due to wear by abrasive solids.
- Siltation or settlement of suspended particulate matter.
- Joint imperfections and fittings

To assist the designer in selecting the appropriate pipe diameter, flow calculation software is available from Iplex Pipelines **www.iplex.com.au** which allows variation in fluid temperature and pipe roughness to suite site conditions.

Alternatively, flow resistant charts for both Rhino<sup>®</sup> Series 1 and Rhino<sup>®</sup> Series 2 PVC-M pipes can be downloaded from the Rhino<sup>®</sup> PVC-M pipeline design section of the Iplex website. The flow resistance charts relate friction loss to discharge and velocity for pipes running full and have been calculated using the Colebrook-White transition equation in the form:

$$V = -2\sqrt{2gdS} \log\left(\frac{k}{3.7d} + \frac{2.51v}{d\sqrt{2gdS}}\right)$$

Where:


V = Mean velocity (m/s)
g = Acceleration due to gravity (m/s<sup>2</sup>)
d = Pipe internal diameter (m)
S = Hydraulic gradient (m/m)
k - Equivalent hydraulic roughness (m)
v = Kinematic viscosity (m<sup>2</sup>/s)

The Colebrook-White transition equation takes into account the variation in viscosity with temperature and pipe roughness and is recognized as being one of the most accurate in general use but requires an iterative solution.

The flow resistance charts have been prepared based on temperature of 20°C which corresponds to a kinematic viscosity for water v =  $1.01 \times 10-6 \text{ m}^2/\text{s}$  and equivalent pipe wall roughness co-efficient, k =  $0.003 \text{ mm} \times 10-3 \text{ m}$ .

This value of the equivalent roughness coefficient "k" assumes the Rhino<sup>®</sup> PVC-M pipeline is straight, clean and concentrically jointed without fittings. Possible values ranging between 0.003 to 0.15mm are given in AS 2200 "Design Charts for Water Supply and Sewerage" for PVC. An approximate allowance for the effect of variation in water temperature can be made by increasing the chart value of the head loss by 1% for each 3°C below 20°C and decreasing by 1% for each 3°C in excess of 20°C.

The hydraulic performance of a pipeline may be adversely affected if combined air release and anti-vacuum valves are not installed at local high points in each section of a pipeline, with maximum spacing not exceeding 500m. These are required to maintain full bore flow and limit the occurrence of sub atmospheric conditions.







### **HYDRAULIC DESIGN**

#### **PRESSURE CLASS SELECTION**

The nominal pressure rating in kilopascals (kPa) of a modified PVC pressure pipe (PVC-M) is equal to PN multiplied by 100. This rated pressure should be exceeded at any location in the pipeline by the maximum operating pressure including water hammer pressure surcharges.

Where the pipeline will be operating at temperatures exceeding 20°C, the nominal rating should be multiplied by the re-rating factor.

Fatigue and structural considerations should also be considered when selecting the pipe class. For example surge pressures commonly known as 'water hammer' must be considered when selecting the pipe class.

Note: PN9 is the minimum class which should be used for full vacuum conditions in a buried pipeline, provided pipes have been embedded in a properly compacted non-cohesive material (such as sand or gravel). The compacted embedment must fully surround the pipe. Pipes installed above ground and subject to vacuum should be specified as a minimum of PN12.

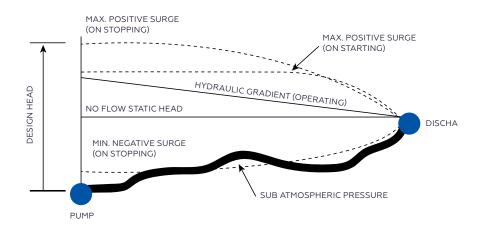


Figure 1.0 Typical hydraulic grades and surge envelopes required for design of Rhino® PVC-M Pipe

The information contained in this document should serve as a guide only and is subject to change without notice. For more information please contact Iplex Pipelines Australia Pty Ltd.





## **HYDRAULIC DESIGN**

#### WATER HAMMER SURGES AND CYCLICAL EFFECTS

Water hammer affects in thermoplastic materials are considerable reduced compared with ductile iron, steel and concrete due to the much lower modulus of elasticity. Typical values for celerities for PVC-M pipes are various pressure classes are provided in Table 1.0.

#### TABLE 1.0 WATER HAMMER CELERITY

MATERIAL	APPROXIMATE CELERITY (M/S)
6	254
9	276
12	319
15	357
16	365
18	382
20	409

PVC-M has characteristics similar to PVC-U, with respect to fatigue under cyclical pressures. The designer should take into account the frequency of the cyclic pressure fluctuations during the life of the pipeline. The amplitude of the pressure change between the maximum and minimum operating pressures, including all transients which dived by the load factor given in Table 1.1 should not exceed the nominal pressure class rating of the pipeline.

In practice the pressure changes in water reticulation systems are seldom of sufficient amplitude and frequency for fatigue to affect pipe class selection, but they can be an important consideration for sewer rising mains.

#### APPROXIMATE NUMBER OF **TOTAL CYCLES** FATIGUE CYCLE FACTOR f CYCLES/DAY FOR 100 YEAR LIFE 26,400 1 1.00 100,000 3 0.67 200,000 5.5 0.54 500,000 14 0.41 27 1,000,000 0.33 2,500,000 68 0.25 5,000,000 137 0.25 10,000,000 274 0.25

#### TABLE 1.1 PVC-M FATIGUE LOAD FACTORS

Reference: PIPA Industry Guidelines "PVC Pressure Pipes, Design for Dynamic Stresses" Issue 1.3 POP101

The information contained in this document should serve as a guide only and is subject to change without notice. For more information please contact Iplex Pipelines Australia Pty Ltd.



WWW.IPLEX.COM.AU • EMAIL INFO@IPLEXPIPELINES.COM.AU V1 2019 PLUMBING, ELECTRICAL AND IRRIGATION 1300 0 IPLEX (1300 0 47539) • CIVIL 13 10 86



### **HYDRAULIC DESIGN**

The frequency is defined as the number of combined pump start and stop cycles. If an allowance is considered necessary to allow for attenuation of water hammer oscillations, the frequency can then be taken as being twice the number of start/stop cycles. (It can be shown mathematically that this is appropriate for the exponential decay typical of pressure surge oscillations).

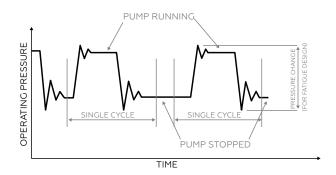


Figure 1.3 Inputs for fatigue design – pressure amplitude and frequency

The dynamic fatigue consideration requires a pipe to be selected with a pressure rating, when multiplied by the fatigue factor, will give a value (Maximum Cyclic Pressure Range) greater than the pressure range or amplitude.





### **HYDRAULIC DESIGN**

### **EXAMPLES**

#### Question 1

A water main will for most of its lifetime experience diurnal operating pressures of 55 metres and 85 metres, that is pressure change amplitude of 30 metres with a total number of cycles over 50 years of 18250 fluctuations.

#### Solution 1

Since the maximum operating pressure is 85 metres and from Table 1.1, the fatigue load factor is 1, a PN9 pipe would be suitable. No de-rating is needed for cycling.

#### **Question 2**

A sewer pump station has a wet sell capacity which will require a pump start (and stop) 3 times per hour on average over a 40 year design life (for the rising main). The static head on the main without pump operation is 12 metres and with a maximum pump station operating of 29 metres. A surge analysis shows the normal shut down phase generates a hammer effect of 32 metre maximum head and a minimum minus 8 metre head at shut down.

#### Solution 2

Steady state operating conditions would suggest that a Class 6 pipe might be selected. However, the amplitude of the maximum pressure transient during the pumping cycle is 32-(-8) = 40 metres and this must be checked for fatigue effect.

The number of cycles used for this check is usually the number of pump stop/start operations. But in this case the number of cycles is to be multiplied by 2 (i.e.  $1,051,200 \times 2=2,102,400$ ) to allow for surge wave attenuation.

The dynamic fatigue consideration requires a pipe to be selected, which will give a maximum cyclic pressure range greater than the pressure fluctuation amplitude of 40 metres. Therefore the class rating can be obtained by dividing the pressure amplitude by the fatigue factor obtained from Table 1.1 for a frequency of 2.1 million pressure fluctuations. (It should be noted that pressure amplitude of 0.25 times the rated pressure is the threshold value below which fatigue will not occur irrespective of frequency). Here 40/0.25 =160m. Therefore the appropriate pipe class selection would be PN16 rated to 160 metres.

