PVC-U PRESSURE PIPE

iplex
Pipelines

PIPELINE DESIGN - STRUCTURAL

FLEXIBLE PIPE DESIGN

In engineering terminology the lplex range of PVC-U pressure pipes are considered to be "flexible" pipes, which means they are designed to deform or deflect diametrically within specified limits without structural damage.

The external soil and live loadings above flexible pipes may cause a decrease in the vertical diameter and an increase in the horizontal diameter of the pipe. The horizontal movement of the pipe walls in the soil material at the sides develops a passive resistance within the soil to support the external load. That is, the pipeline performance is influenced by the soil type, density and height of water table. The higher the effective soil modulus at pipe depth, the less the pipe will deflect.

Initial deflections of up to 3% are permissible and will not affect the pressure rating of the pipe. A complete design procedure is available for lplex PVC-U pipes. Consult lplex for further details or refer to AS/NZS 2566.1 "Buried flexible pipelines Part 1 Structural design". lplex has developed computer software, which is available for download, free of charge. It is based on this standard and covers all its pipeline materials in addition to Series 1 PVC-U.

TABLE 1.0 - TYPICAL STIFFNESS FOR PVC-U PRESSURE

NOMINAL PRESSURE PN	ESTIMATED STIFFNESS (N/MM)
4.5	2, 230
6	5, 400
9	19, 800
12	49, 760
15	71, 600
16	136, 500
18	205, 900
20	301, 400

MINIMUM COVER HEIGHTS -AS/NZS 2566

For areas with no traffic loading a minimum cover height of 450mm to the top of the pipe should be adopted. Under sealed roadways the minimum cover height is 600mm and in unsealed roadways, 750mm.

Pipe embedment material should have a minimum compaction Density Index of 65% or standard dry density compaction of 90%. After pipes are laid and centred in the trench, the embedment material should be compacted in 80-100mm layers to the specified density. The embedment should continue 80mm to 150mm above the pipe to provide protection from the backfill.

The information contained in this document should serve as a guide only and is subject to change without notice. For more information please contact Iplex Pipelines Australia Pty Ltd.

PVC-U PRESSURE PIPE

PIPELINE DESIGN - STRUCTURAL

THRUST BLOCK DESIGN FOR FITTINGS

For rubber ring jointed pipeline systems provision must be made for potentially unrestrained forces at changes of size or direction. For e.g, bends, tees, reducers, valves and closed ends.

In buried installations, fittings are usually restrained by blocks of concrete cast in-situ. These thrust blocks are formed and sized to distribute the applied force from the fitting to a safe soil pressure / concrete interface. The resistance provided will depend on the soil type and depth.
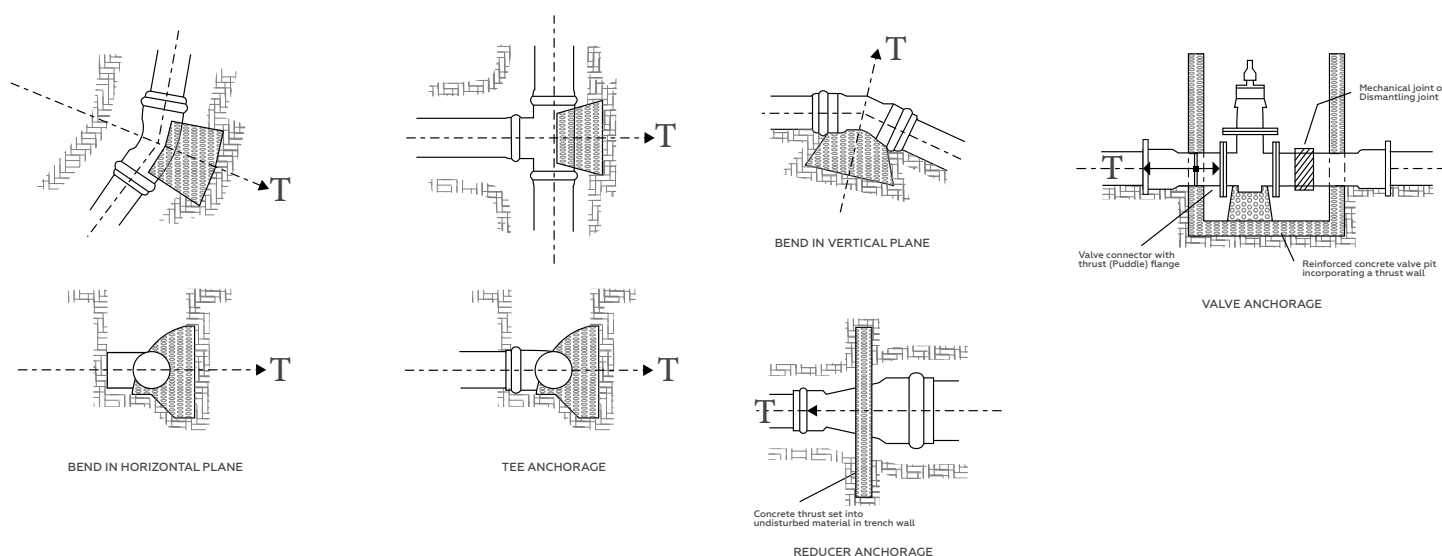
Where bends are in the vertical plane, convex and close to the surface, the mass of a concrete anchor block alone may have to be the restraining force.

AS/NZS 2566.2 and AS2032 specify the use of thrust blocks for all in-line gate valves. Although no longer allowed, Water Agencies have in the past omitted valve restraints for small diameter (S ON 200) reticulation pipelines.

Where there is risk of axial thrust, it is strongly recommended that only those DI fittings with full circle bearing surfaces at the base of the socket should be used. It is also beneficial if the PVC-U spigots are trimmed back and the chamfer reduced to DI chamfer lengths. This serves to increase the effective end bearing area for the PVC spigot inside the DI socket.

Installers should be alerted to the potential for catastrophic failure where there is insufficient buried pipe downstream of an unanchored valve to provide enough soil friction to resist the hydrostatic thrust when the valve is closed.

Figure 1.0 - Typical thrust block arrangements (Reference AS/NZS 2566)

BEND IN HORIZONTAL PLANE

TEE ANCHORAGE

BEND IN VERTICAL PLANE

Concrete thrust set into undisturbed material in trench wall

REDUCER ANCHORAGE

Mechanical joint or Dismantling joint

Valve connector with thrust (Puddle) flange

Reinforced concrete valve pit incorporating a thrust wall

VALVE ANCHORAGE

The information contained in this document should serve as a guide only and is subject to change without notice. For more information please contact Iplex Pipelines Australia Pty Ltd.

PVC-U PRESSURE PIPE

iPLEX
Pipelines

PIPELINE DESIGN - STRUCTURAL

TABLE 2.0 HYDROSTATIC FORCES (KN) ON RUBBER RING JOINTED FITTINGS PER 10METRES OF HYDROSTATIC HEAD

PIPE DN	PIPE OD	BEND 90°	BEND 45°	BEND 22½°	BEND 11°¼	TEE/ CLOSED END VALVE
100	122	1.62	0.88	0.45	0.22	1.15
150	177	3.41	1.85	0.94	0.47	2.41
200	232	5.86	3.18	1.61	0.81	4.41
225	259	7.31	3.96	2.01	1.01	5.17
250	286	8.91	4.83	2.45	1.23	6.30
300	345	12.96	7.02	3.57	1.79	9.16

Note: For concentric reducers the resultant thrust will be the difference between the "closed end" forces for the two pipe sizes.

TABLE 3.0. SOIL BEARING CAPACITIES (kPa)

SOIL GROUP DESCRIPTION AS PER AS 1786	MINIMUM SOIL COVER ABOVE CENTRE LINE OF THRUST BLOCK IN METRES			
	0.75	1.0	1.25	1.5
GW, SW	57	76	95	114
GP, SP	48	64	80	97
GM, SM	48	64	80	96
GC, SC	79	92	105	119
CL	74	85	95	106
ML	69	81	93	106
OH	0	0	0	0

Note: For concentric reducers the resultant thrust will be the difference between the "closed end" forces for the two pipe sizes.

The information contained in this document should serve as a guide only and is subject to change without notice. For more information please contact Iplex Pipelines Australia Pty Ltd.

WWW.IPLEX.COM.AU • EMAIL **INFO@IPLEXPIPELINES.COM.AU**
PLUMBING, ELECTRICAL AND IRRIGATION **1300 0 IPLEX (1300 0 47539)** • CIVIL **13 10 86**

V1 2019

3

PVC-U PRESSURE PIPE

PIPELINE DESIGN - STRUCTURAL

Thrust blocks must be configured to distribute the hydrostatic force to a 'wall' of undisturbed soil, which is approximately perpendicular to the imposed load.

The equation for this calculation is:

$$A = (T/b) \times f$$

Where,
A = area perpendicular to force (m^2)
T = hydrostatic thrust (kN)
b = soil bearing capacity (kPa)
f = factor of safety (in the order of 1.1 to 1.5)

Example:

Question: A DN300 PVC-U pipeline has a maximum operating head (include field test heads) of 150 metres. What is the minimum area for a thrust block for a 90° ductile iron bend buried with 1 metre cover to the centre-line in a type SC soil?

Solution: From Table 6.2, the hydrostatic thrust 'T' is 12.96kN x 15 = 194.4 kN.

From Table 3.0, 'b' = 92 kPa.

Therefore:

A= (194.4 / 92) x 1.1 = 2.32 m^2